


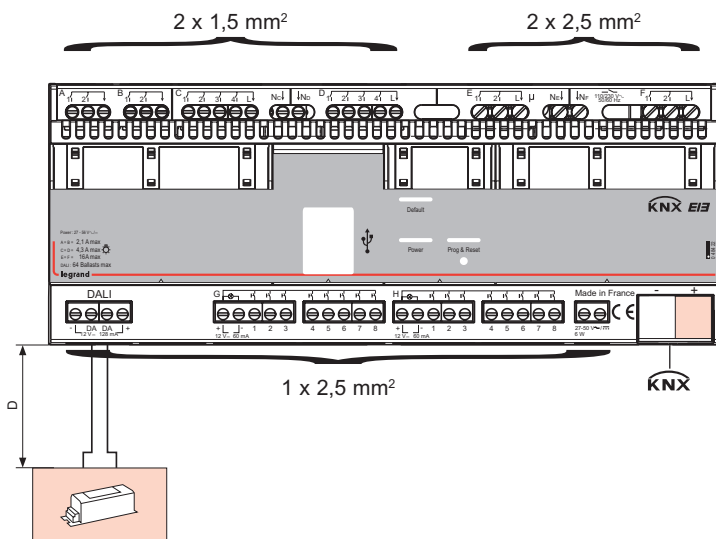

	27-50 V TBTS
	4 x ( $\varnothing 0,6 < \text{---} < \varnothing 0,8$ ) 8 mm
X = 	x = 12
	-5°C → +45°C
	NF EN50428 IEC 60669-2-1









D	Ø
≤ 100 m	0,5 mm <sup>2</sup>
≤ 150 m	0,75 mm <sup>2</sup>
≤ 300 m	1,5 mm <sup>2</sup>





A - B	230 V~	80 VA	0,3 A	250 VA	1,1 A	250 VA	1,1 A	2 (2 x 36) W	0,8 A	80 VA	0,3 A	80 VA	0,3 A	500 W	2,1 A	250 VA	1,1 A	250 VA	1,1 A
	110 V~	40 VA		125 VA		125 VA		1 (2 x 36) W		40 VA		40 VA		250 W		125 VA		125 VA	
	12 - 48 V~ V~N=	80 VA	0,3 A												250 VA	1,1 A	250 VA	1,1 A	
C - D	230 V~	160 VA	0,7 A	500 VA	2,1 A	500 VA	2,1 A	4 (2 x 36) W	1,7 A	160 VA	0,7 A	160 VA	0,7 A	1000 W	4,3 A	500 VA	2,1 A	500 VA	2,1 A
	110 V~	80 VA		250 VA		250 VA		2 (2 x 36) W		80 VA		80 VA		500 W		250 VA		250 VA	
E - F	230 V~	500 VA	2,1 A	1000 VA	4,3 A	1000 VA	4,3 A	10 (2 x 36) W	4,3 A	500 VA	2,1 A	500 VA	2,1 A	3680 W	16 A	500 VA	2,1 A	500 VA	2,1 A
	110 V~	250 VA		500 VA		500 VA		5 (2 x 36) W		250 VA		250 VA		1760 W		250 VA		250 VA	

DALI	
230 V~	64 ballasts Maxi
110 V~	

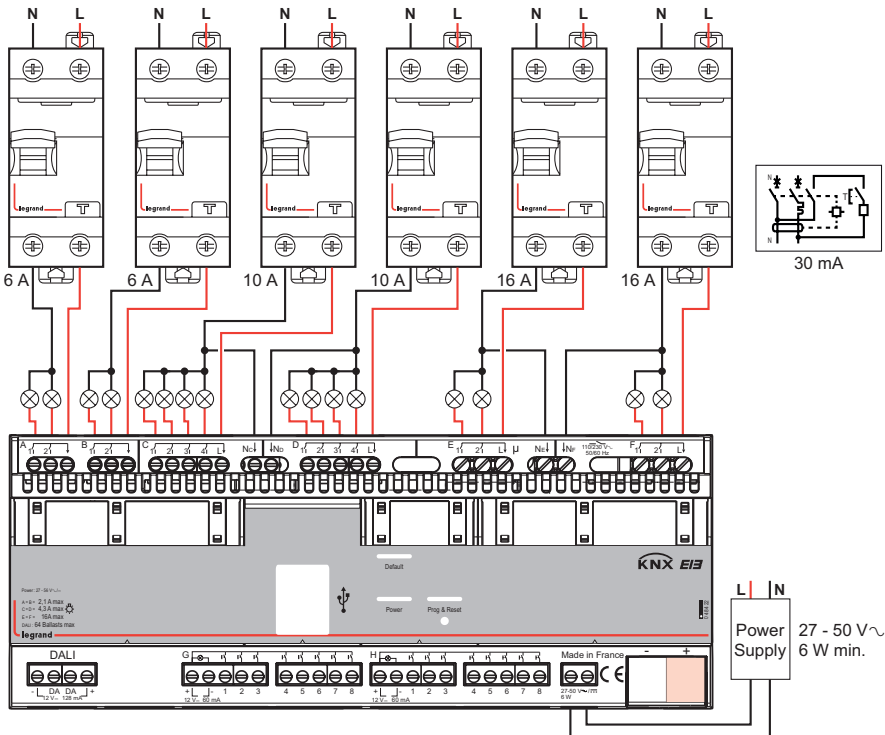

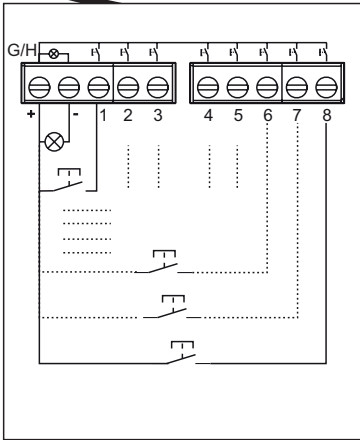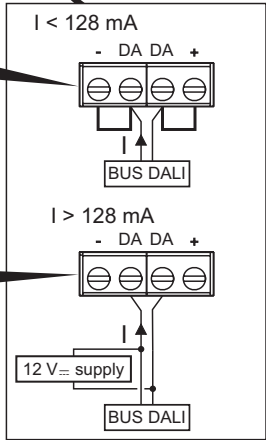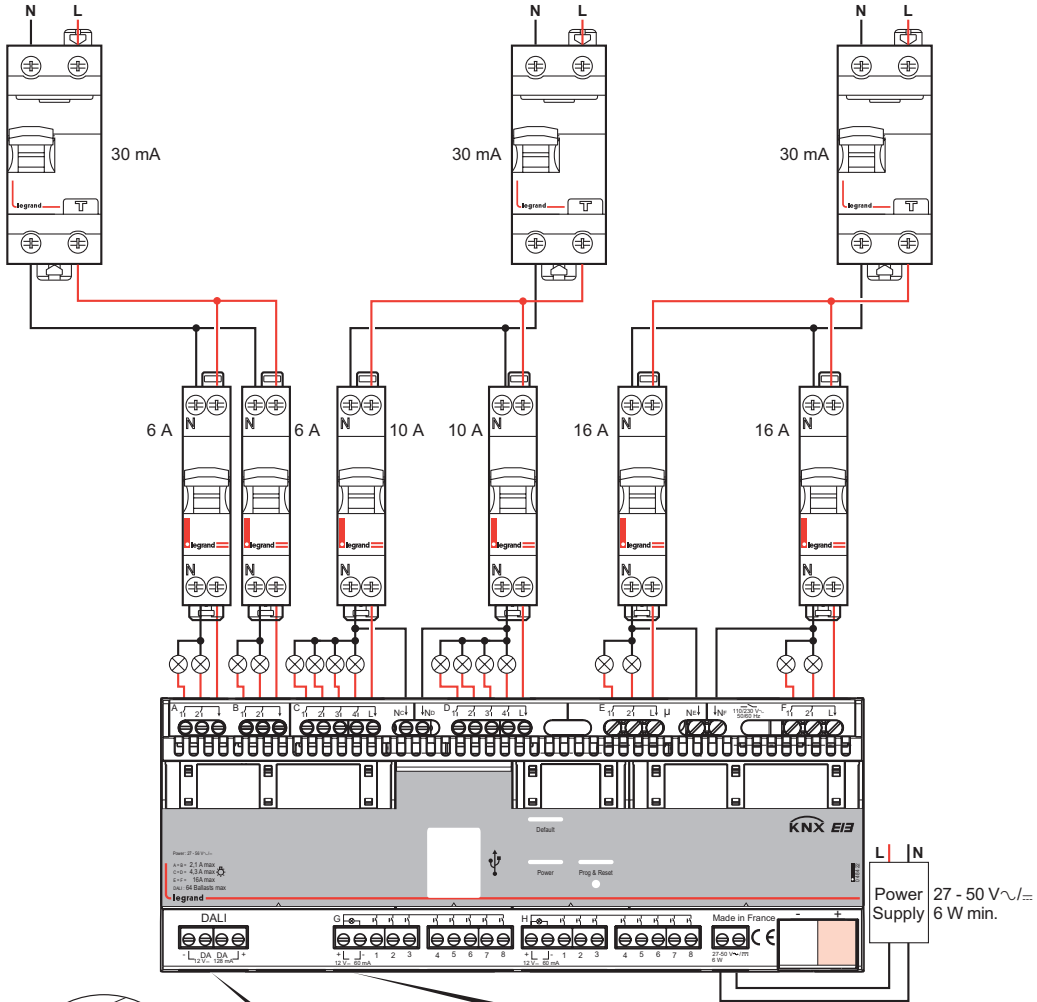


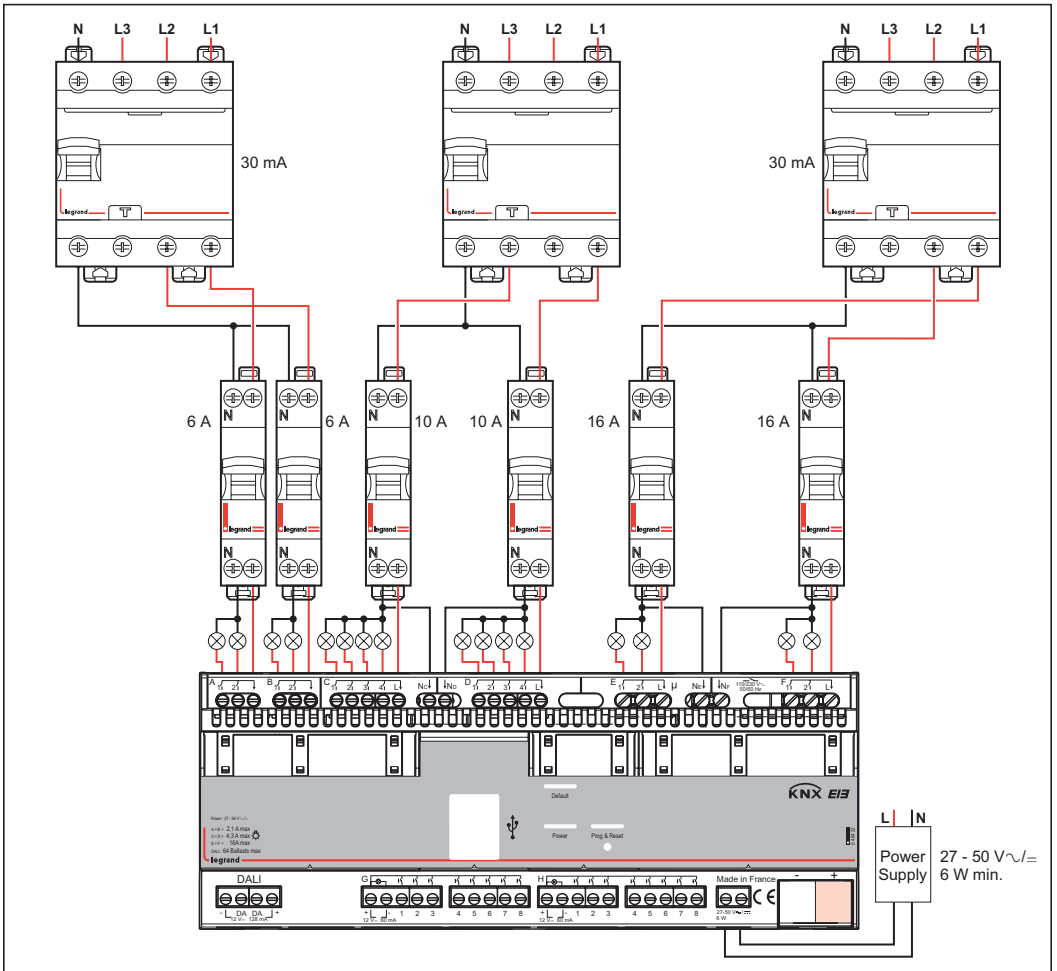

OK



[www.legrandoc.com](http://www.legrandoc.com)

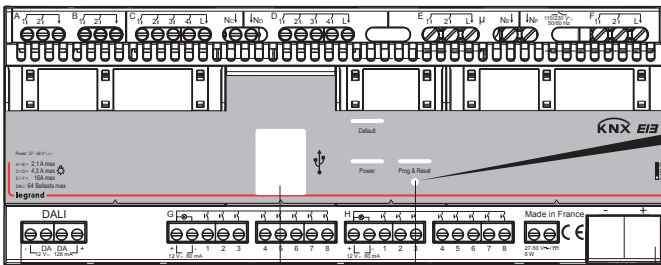

DALI

USB

Programmation & Reset

KNX